



T E N T A T I V E

DESCRIPTION:

THE F-7847 IS A 10 WATT CW TRAVELING WAVE AMPLIFIER TUBE HAVING 27 DB GAIN AND 5.0 TO 6.0 FREQUENCY RANGE. IT IS CONSTRUCTED IN A RUGGED METAL ENVELOPE WITH A HELIX TYPE SLOW WAVE STRUCTURE. THE INTEGRAL MATCHING CIRCUIT IS IN 50 OHM COAXIAL LINE AND IS PROVIDED WITH FEMALE TNC CONNECTORS. THE TUBE IS SELF-ALIGNING IN THE EXTERNAL SOLENOID, WHICH IS REQUIRED TO PROVIDE A UNIFORM MAGNETIC FIELD. A CONVERGENT BEAM GUN AND OXIDE COATED CATHODE ARE USED. THE TUBE IS SUITABLE FOR EITHER CW OR PULSE SERVICE.

ELECTRICAL INFORMATION:

HEATER VOLTAGE	6.3 ( <sup>t</sup> -5%)	VOLTS
HEATER CURRENT	2.2	AMPERES
MAXIMUM FREQUENCY	6.0	
MINIMUM FREQUENCY	5.0	
MINIMUM COLD TRANSMISSION LOSS	55	DB
CAPACITANCE		
CONTROL ELECTRODE TO ALL ELEMENTS	15	UUF

ELECTRICAL RATINGS, ABSOLUTE VALUES:

MAXIMUM ANODE VOLTAGE (NOTE 1)	3000	VOLTS
MAXIMUM HELIX CURRENT (NOTE 2)	2	MA
MAXIMUM COLLECTOR DISSIPATION (BEAM POWER) (NOTE 3)	196	WATTS
MAXIMUM CONTROL ELECTRODE VOLTAGE	0	VOLTS

MECHANICAL:

TYPE OF CATHODE	OXIDE COATED UNIPOTENTIAL
GUN CONNECTIONS	FLYING LEADS
R-F CONNECTIONS	FEMALE TNC
MAGNETIC FIELD STRENGTH	1200 GAUSS
MOUNTING POSITION	ANY
WEIGHT (TUBE ONLY)	14 OZ.
TYPE OF COOLING (NOTE 4)	WATER OR AIR

TYPICAL OPERATION:

ANODE VOLTAGE	2800	VOLTS
ANODE CURRENT	67	MA
HELIX CURRENT	1.0	MA
CONTROL ELECTRODE VOLTAGE	0	VOLTS
POWER OUTPUT	10	WATTS
GAIN	27	DB
DUTY CYCLE (NOTE 5)		
R-F	VARIABLE TO	1.0
BEAM		1.0

NOTE 1: ALL VOLTAGES SHOWN ARE WITH RESPECT TO CATHODE. ANODE, COLLECTOR AND OUTER COAX CONDUCTOR OF THE R-F TERMINALS ARE CONNECTED INTERNALLY TO THE SHELL AND ARE OPERATED AT GROUND POTENTIAL. THE HELIX IS CONNECTED TO THE CENTER CONDUCTOR OF THE COAX LINE AND A D.C. CONNECTION TO THE HELIX MUST BE PROVIDED EXTERNALLY IN THE R-F CIRCUITRY.

NOTE 2: THE HELIX CURRENT SHOULD BE MINIMIZED AND MUST BE LESS THAN THE MAXIMUM RATING. IT IS DESIRABLE TO MONITOR THIS CURRENT DURING OPERATION AND TO PROVIDE OVERLOAD PROTECTION. IN PULSED BEAM OPERATION, THE PEAK HELIX CURRENT MAY EXCEED 2 MA, BUT CARE SHOULD BE TAKEN TO OPERATE AT REASONABLY LOW VALUES AND AVERAGE CURRENT MUST NOT EXCEED 2 MA.


NOTE 3: THE BEAM VOLTAGE SHOULD BE APPLIED TO THE TUBE ONLY AFTER THE MAGNETIC FIELD IS TURNED ON AND WATER OR AIR IS FLOWING THROUGH THE COLLECTOR COOLING JACKET.

NOTE 4: COOLING METHOD DEPENDS ON TYPE OF COLLECTOR COOLING JACKET USED.

NOTE 5: GATED BEAM OPERATION CAN BE UTILIZED BY PULSING ANODE VOLTAGE IN THIS TYPE OF OPERATION, THE VALUES OF POWER OUTPUT, ANODE CURRENT AND HELIX CURRENT BECOME PEAK VALUES.

ADDITIONAL INFORMATION FOR SPECIFIC APPLICATIONS CAN BE OBTAINED FROM THE:

ELECTRON TUBE APPLICATIONS SECTION  
ITT COMPONENTS DIVISION  
POST OFFICE BOX 7065  
ROANOKE, VIRGINIA

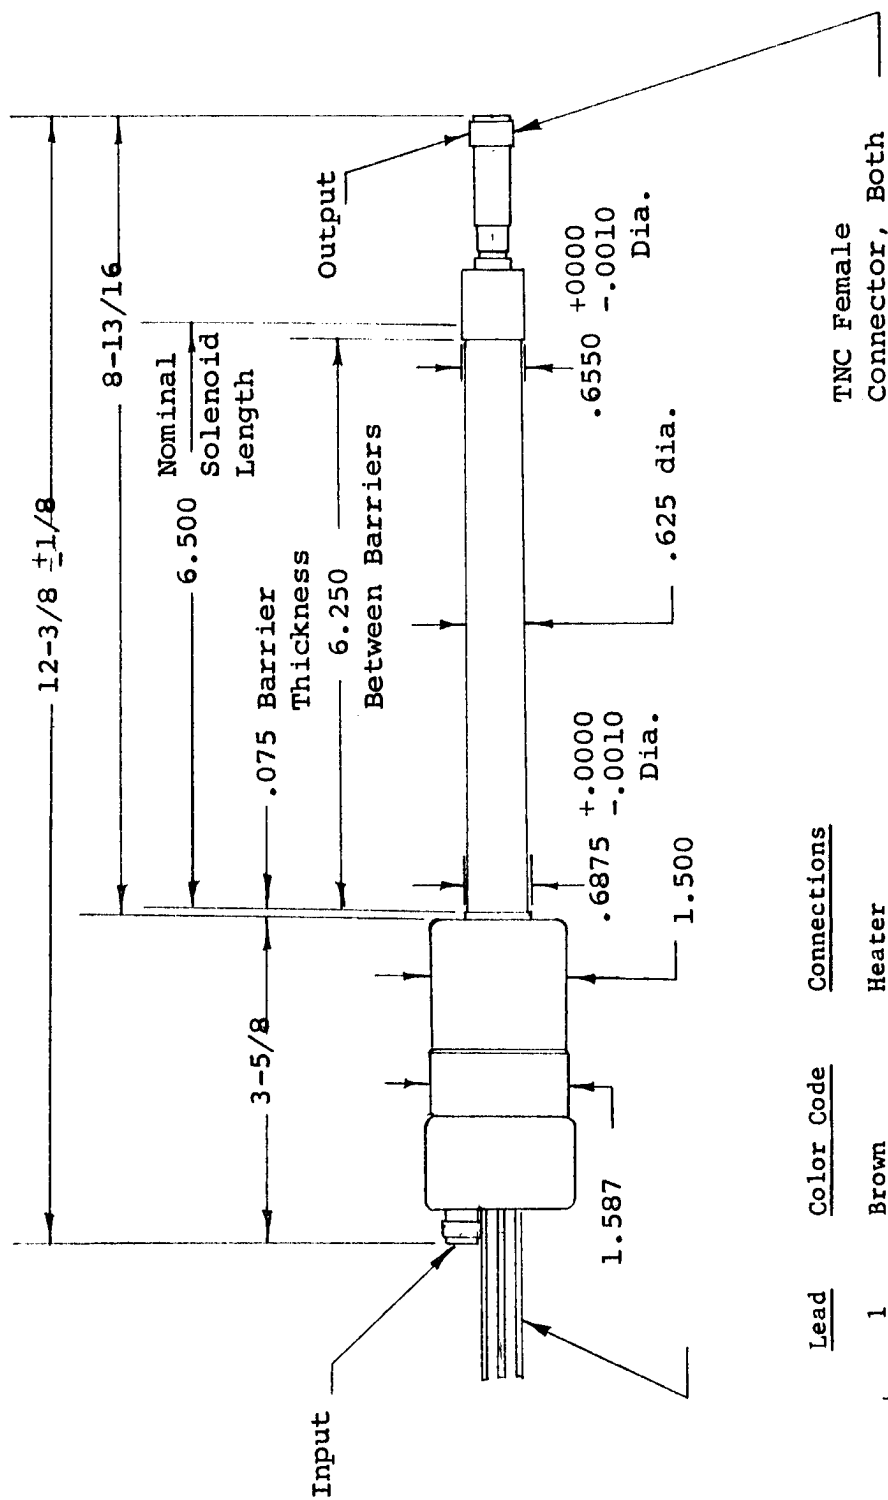


TNC Female Connector, Both Ends.

Connections  
 Heater  
 Control Electrode  
 Anode, Capsule and Collector  
 Heater-Cathode

Color Code  
 1 Brown  
 2 Green  
 3 Black  
 4 Yellow

Lead  
 1  
 2  
 3  
 4  
 Flexible Leads 12" Min. Length



OUTLINE - F-7847

